



**NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.**

Ref: PUR-IHP-1008249

Date: 11.09.2024

ADDENDUM NO. 1 TO LETTER INVITING TENDER

Job Name: Supply and Retrofit of Air circuit breaker in 415 V, 3-phase feeder panel without modification of the Main Busbar

Tender No. OC15000340/SAR dated 23.08.2024

1. Kindly find herewith the following addendum to the Notice Inviting Tender (NIT)

Sl.No.	Query	Response
1	Dimension of the cubicle where the ACB to be retrofitted ---- HxDxW	GA drawing has been attached
2	Application	Motor Feeder
3	Busbar used in your panel whether Copper/Aluminium	Aluminium Busbar
4	Present Indications at your panels	ON/OFF/Trip/Trip Circuit Healthy
5	Existing Control Circuit Diagram	Available, will be shared after awarding the Contract
6	No of visit required for completion of the job	Will complete in one go
7	Photographs of existing ACB	Photographs attached below

2. The due date of submission of bid has been extended to **18.09.2024: Time 11:00 A.M**

CGM (Commercial)
Numaligarh Refinery Limited,
Numaligarh, Dist : Golaghat,
Assam – 785 699


Copy to: NRL website (www.nrl.co.in)



NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.

GA of Panel

ASC35140008

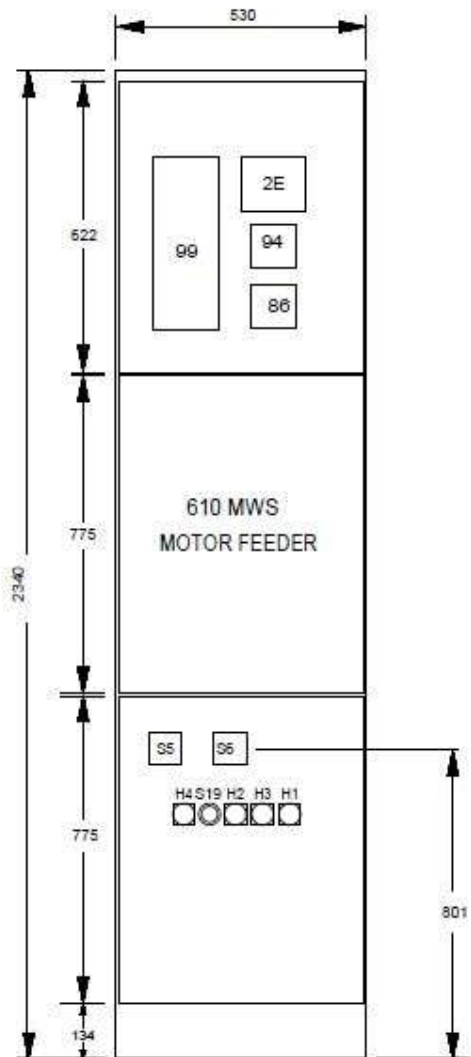



NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.

Front View of Panel





NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.


Front View





NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.

Relay 1

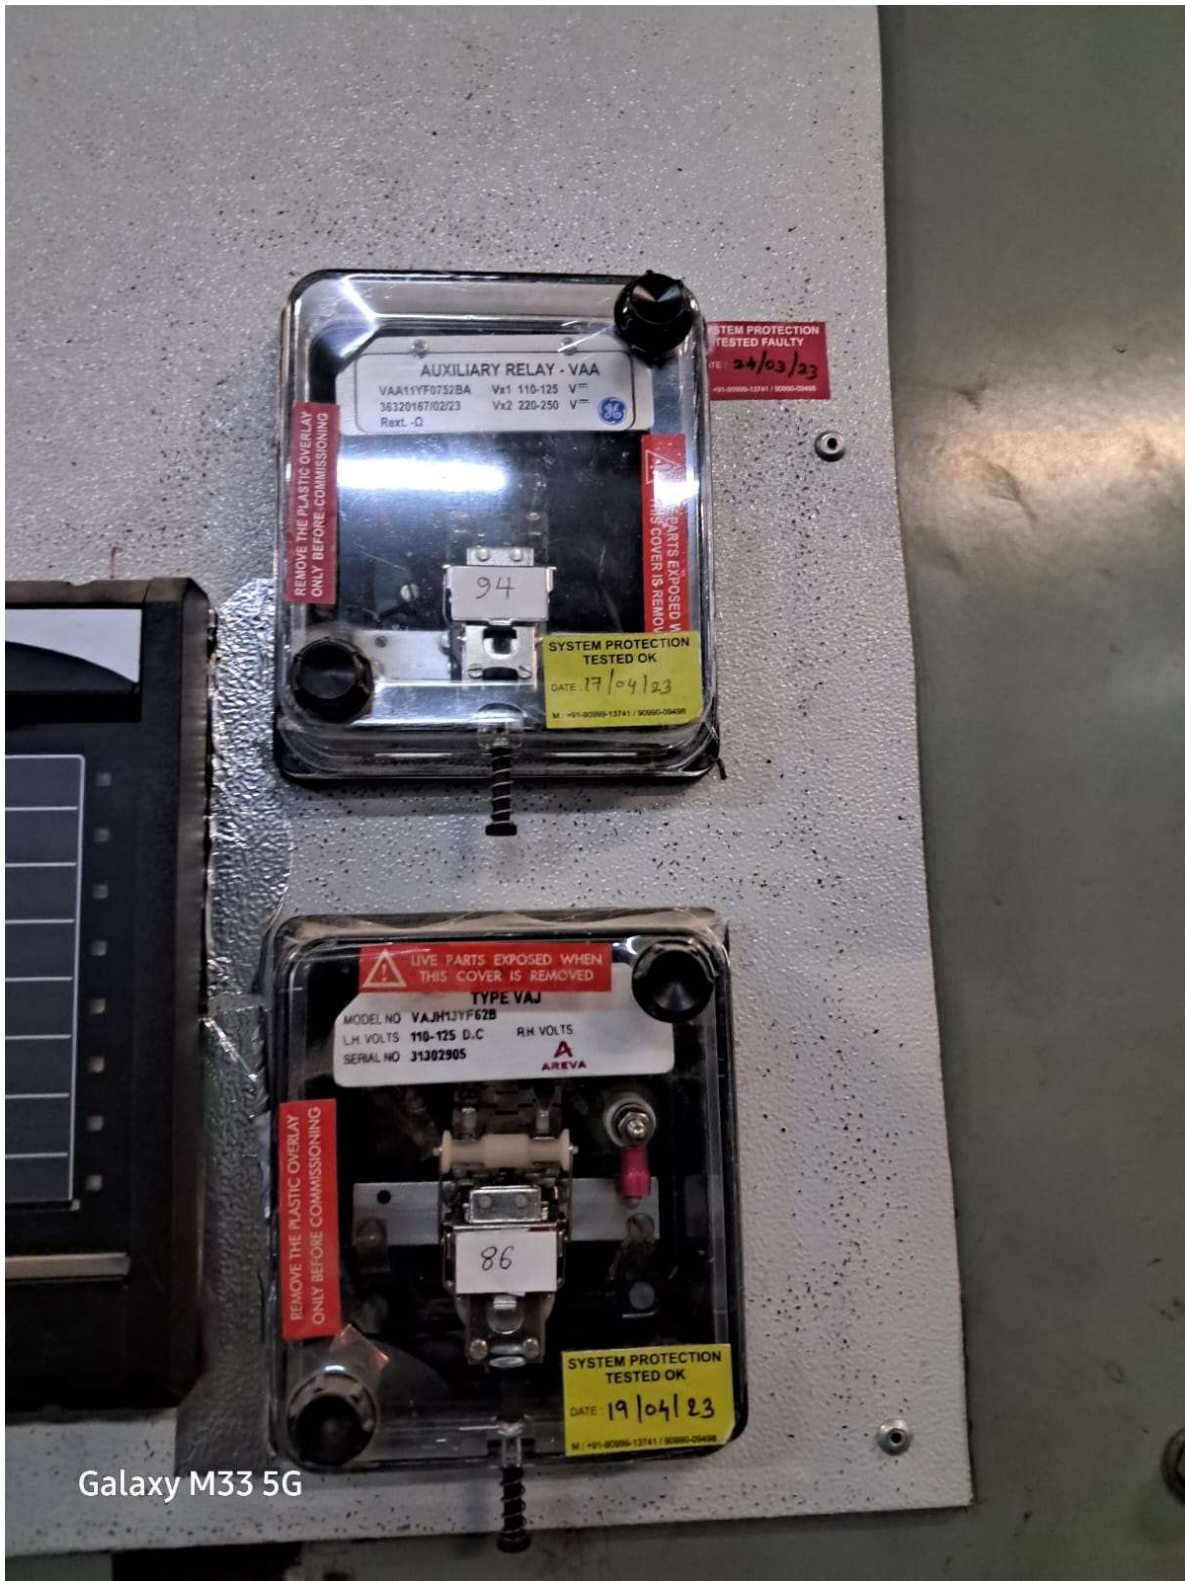

Galaxy M33 5G



NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.

Relay 2




Galaxy M33 5G



**NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.**


Back view of Panel

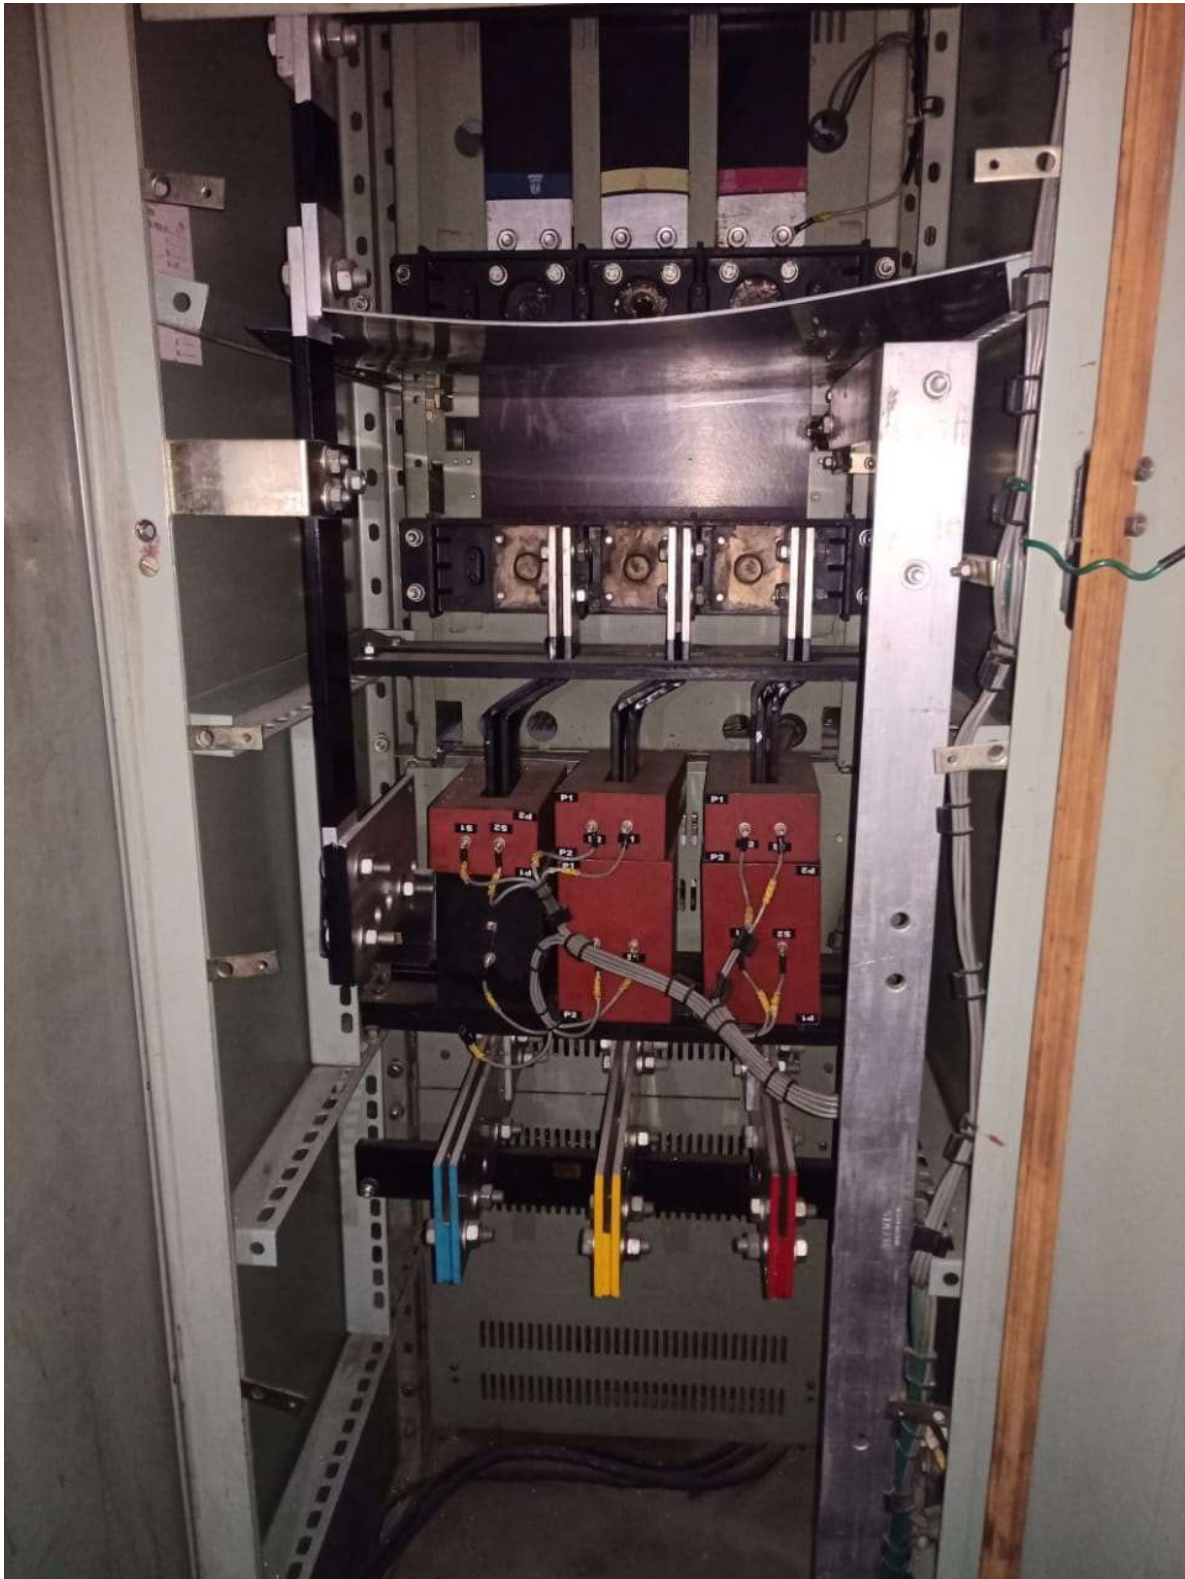



NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.

CT Arrangement

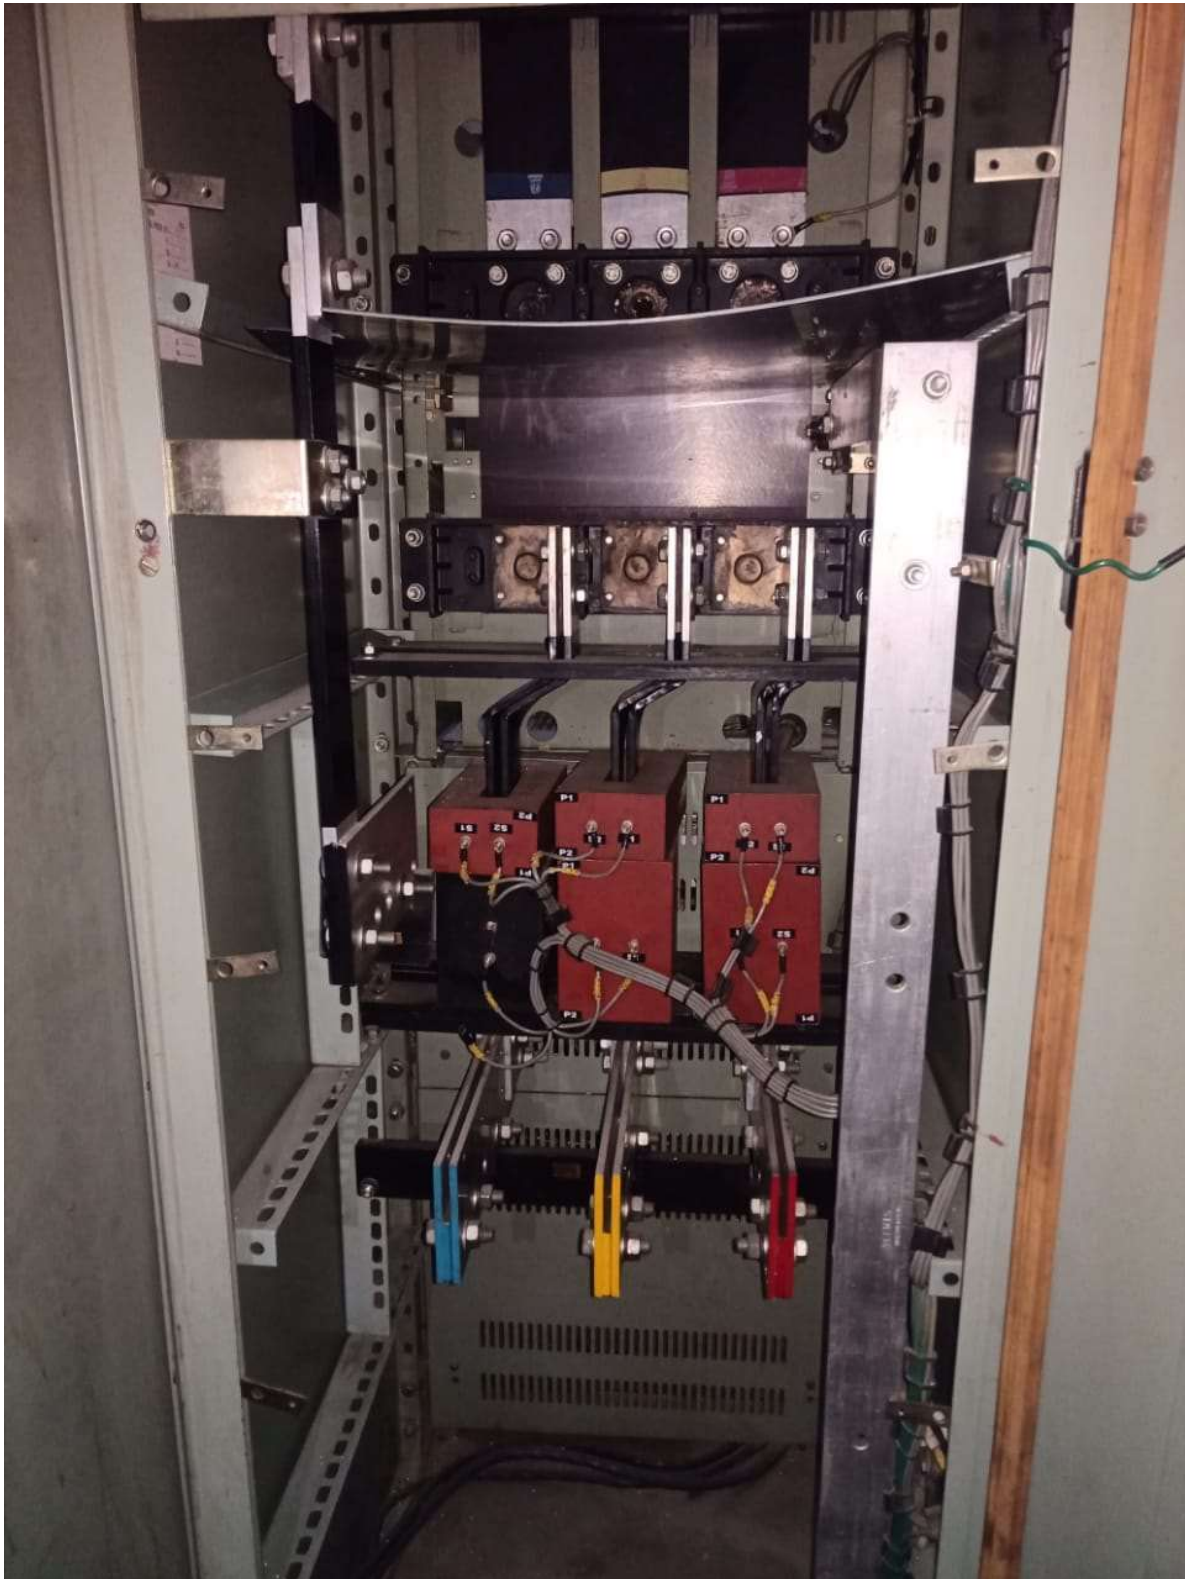



**NUMALIGARH REFINERY LIMITED.
COMMERCIAL DEPARTMENT.**

Door Panel 1



Door panel 2

